

# Improved Power System Stabilizer by Applying LQG Controller

ALI M. YOUSEF<sup>1</sup>, MOHAMED ZAHRAN<sup>2</sup> & GHAREEB MOUSTAFA<sup>3</sup>

1. Electrical Eng. Dept. Faculty of Engineering, Assiut University, 71516 Egypt,
2. Electronics Research Institute, Photovoltaic Cells Departments, NRC Bldg., El-Tahrir St., Dokki, 12311-Giza, Egypt,
3. Electrical Eng. Dept. Faculty of Engineering, Suez Canal University, Ismailia, Egypt,  
[drali\\_yousef@yahoo.com](mailto:drali_yousef@yahoo.com), [mbazahran\\_2007@yahoo.com](mailto:mbazahran_2007@yahoo.com), [ghareebmoustafa@gmail.com](mailto:ghareebmoustafa@gmail.com)

**Abstract:** Power system stabilizers (PSSs) are traditionally used to provide damping torque for the synchronous generators to suppress the oscillations by generating supplementary control signals for the generator excitation system. Numerous techniques have previously been proposed to design PSSs but many of them are synthesized based on a linearized model. The dynamic characteristics of the proposed PSS are studied in a typical synchronous machine connected to infinite-bus of power system through transmission line. This paper deals with the applying of the Linear Quadratic Gaussian (LQG) technique to the design of the robust controller for two models of power system. The first model represents only the electrical control part of power system by means synchronous generator connected to infinite bus, while the second model, adding a turbine and governor to the model 1. Combined the Kalman filter, which is an optimal observer with the optimal LQR regulator to construct the optimal LQG controller are evaluated. Electromechanical oscillations of small magnitude and low frequency exist in the power system operation and often persist for long periods of time. Simulation results show the proposed PSS is robust for such nonlinear dynamic system and achieves better performance than the conventional PSS in damping oscillations.

**Key Words:** Power System Stabilization, Advanced Controller, Robust Systems Control, LQR, LQG

## 1. Introduction

The power flow at and around the nominal power frequency, all electrical and electromechanical power systems involve a wide range of resonant oscillatory modes. Due to the proximity of generation to the load, small variations in the system load can excite the voltage oscillation due to reactive power mismatch which must be damped to maintain secure and stable system operation. Conventional excitation controllers coupled with power system stabilizers (PSSs) for centralized generation are usually designed based on linearized models. As the load over the entire transmission gets averaged out, linearized generator models are appropriate for designing the oscillation damping controller. But in power distribution systems (PDSs), the load change in proportion to the generation is large and linearized generator models are constantly changing. In such situations, robust control is essential [1]. Damping inter-area oscillations is one of the major concerns for the electric power system operators. With ever increasing power exchange between utilities over the existing transmission network, the problem has become even more challenging. Secure operation of power systems, thus, requires the application of robust controllers to damp these inter-area oscillations. Power system stabilizers (PSSs) are the most commonly used devices for this purpose. The task of control design is challenging, owing to the

complex nature of the interactions in the inter-area modes of the system. Methods received increased attention in power systems; however, issues with weighting function selection make the whole design procedure difficult. Linear quadratic Gaussian (LQG) control approaches using different FACTS devices have been presented for closed-loop identification in, and power system stabilizer (PSS) for small systems in [2].

The basic objective of the control system is the ability to measure the output of the system, and to take corrective action if its value deviates from some desired value. The voltage regulator is the intelligence of the system and controls the output of the exciter so that the generated voltage and reactive power change in the desired way. As the number of power plants with automatic voltage regulators grew, it became apparent that the high performance of these voltage regulators had a destabilizing effect on the power system. Power oscillations of small magnitude and low frequency often persisted for long periods of time. In some cases, this presented a limitation on the amount of power able to be transmitted within the system. Power system stabilizers were developed to aid in damping of these power oscillations by modulating the excitation supplied to the synchronous machine [3].

The LQG control design method is considered to be a cornerstone of the modern optimal control theory and is based on the minimization of a cost

function that penalizes states' deviations and actuators' actions during transient periods. The main advantage of LQG control is its flexibility and usability when specifying the underlying trade-off between state regulation and control action [4]. Linear Quadric Gauss optimal control (LQG) has been proved to be a significant method which could effectively solve the random noise problem and achieve optimum performance [5]

In this paper, a proposed robust approach based on LQG control theory is presented to overcome the above-mentioned problems of the linear controls by explicitly using a nonlinear model of the power system for control synthesis. Finally, the power system stabilizers (PSS) are added to excitation systems to enhance the damping during low frequency oscillations. The main aim of research dealing with power system stabilizer (PSS) design for synchronous generator excitation systems to assures damping of the power system transient processes under various operating conditions [6] [7].

## 2. Power System Modeling

### 2.1. Model 1: Excitation System

The power system under study in this work consists of synchronous machine connected to an infinite bus through a transmission line. The 4th order model has presented of a synchronous machine connected to an infinite bus as shown in Figure 1.

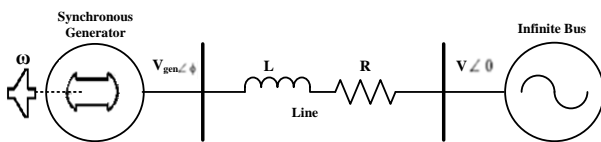


Figure 1: Single line diagram of the power system

The differential equations describing this model are given by [8]:

$$\Delta \dot{\delta} = \omega_0 \Delta \omega \tag{Eq. 1}$$

$$\Delta \dot{\omega} = \frac{1}{M} (-K_1 \Delta \delta - D \Delta \omega - K_2 \Delta E'_q) \tag{Eq. 2}$$

$$\Delta \dot{E}'_q = \frac{1}{T_{do}} (-k_4 \Delta \delta - (\Delta E'_q / k_3) + E_{fd}) \tag{Eq. 3}$$

$$\dot{E}_{fd} = \frac{1}{T_A} \left( -k_A k_5 \Delta \delta - k_A k_6 \Delta E'_q - \Delta E_{fd} + k_A U \right) \tag{Eq. 4}$$

Where:

- $\Delta \delta$  :Deviation of the rotor angle
- $\Delta E'_q$  :Transient Voltage proportional to q-axis flux linkage
- M :Constant proportional to inertia
- $T_{do}$  :Open circuit transient time constant
- $K_A$  :Gain constant

- $\Delta \omega$  :Deviation of the rotor speed
- $\Delta E_{fd}$  :Generator field voltage
- D :Damping coefficient
- $T_A$  :Exciter time constant

Figure2 , shows the block diagram of the model based on the mathematical model given by Eq.1 to Eq.4

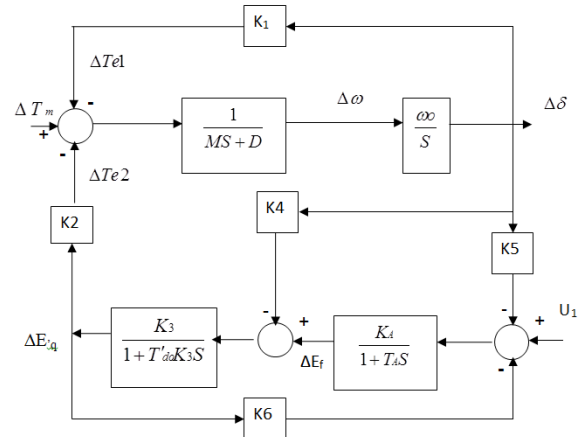


Figure2 : Block diagram of the model power system [8], [9].

The differential Eq.1 to Eq4 can be written in matrix form as follows:

$$\dot{X} = AX + BU$$

$$Y = CX + DU$$

Eq. 5

Where:

$$A = \begin{pmatrix} 0 & \omega_0 & 0 & 0 \\ -K_1 & -D & -K_2 & 0 \\ M & M & M & 0 \\ -K_4 & 0 & -1 & 1 \\ \frac{T'_{do}}{T_A} & 0 & \frac{K_3 T'_{do}}{T_A} & \frac{T'_{do}}{T_A} \\ -K_A K_5 & 0 & -K_A K_6 & -1 \\ T_A & 0 & T_A & T_A \end{pmatrix} :$$

The system matrix,

$$X = \begin{pmatrix} \Delta \delta \\ \Delta \omega \\ \Delta E'_q \\ \Delta E_{fd} \end{pmatrix} :$$

The state vector

$$B = \begin{pmatrix} 0 \\ 0 \\ 0 \\ \frac{K_A}{T_A} \end{pmatrix} :$$

$$U = -KX$$

The control signal

### 2.2. Model II : Interconnected power system

A synchronous machine connected to infinite bus through transmission line is obtained in an interconnected power system between automatic voltage regulation and load frequency control as shown in a block diagram of Figure 3 the state space formulation can be obtained as follows:

The input vector,

$$C = (1 \quad 1 \quad 0 \quad 0) :$$
 The output vector

$$D = (0),$$

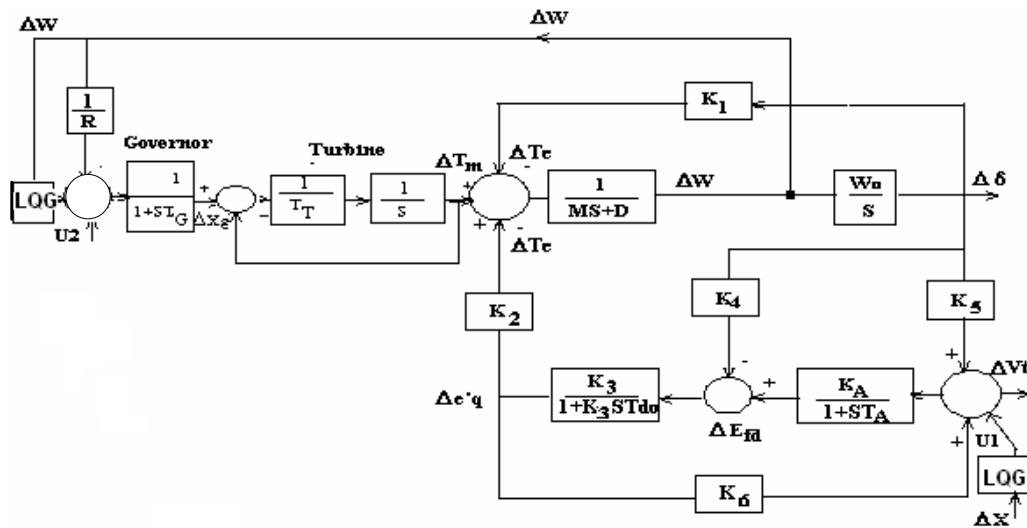


Figure 3: The block diagram of interconnected power system [10].

#### 2.2.1. Steady-state Representation

$$\Delta \dot{\delta} = \omega_o \Delta w \tag{Eq.6}$$

$$\Delta \dot{P}_g = -(1/RT_g)\Delta w - (1/T_g)\Delta P_g + (1/T_g)U_2 \tag{Eq.10}$$

$$\Delta \dot{w} = -(K_1/M)\Delta \delta - (D/M)\Delta w - (K_2/M)\Delta E'q + (1/M)\Delta T_m - (1/M)\Delta P_d \tag{Eq.7}$$

$$\Delta \dot{E}_{fd} = -(1/T_A)\Delta E_{fd} - (K_A K_5/T_A)\Delta \delta - (K_A K_6/T_A)\Delta e'q + (K_A/T_A)U_1 \tag{Eq.11}$$

$$\Delta \dot{E}_q = -(K_4/T'do)\Delta \delta - (1/K_3 T'do)\Delta E'q + (1/T'do)\Delta E_{fd} \tag{Eq.8}$$

It can be written in a matrix form as follows:

$$\Delta \dot{T}_m = -(1/T_t)\Delta T_m + (1/T_t)\Delta P_g \tag{Eq.9}$$

$$\Delta \dot{X} = A\Delta X + B\Delta U + \eta\Delta P_d \tag{Eq.12}$$

Where;

$$\Delta X = [\Delta \delta \quad \Delta \omega \quad \Delta E'_q \quad \Delta T_m \quad \Delta P_g \quad \Delta E_{fd}]^T$$

$$B = \begin{bmatrix} B_1 \\ B_2 \end{bmatrix}^t = \begin{bmatrix} 0 & 0 & 0 & 0 & 0 & \frac{K_A}{T_A} \\ 0 & 0 & 0 & 0 & \frac{1}{T_g} & 0 \end{bmatrix}^t$$

$$\Delta U = [\Delta U_1 \quad \Delta U_2]^t \tag{Eq. 13}$$

$$\eta = \begin{bmatrix} 0 & \frac{-1}{M} & 0 & 0 & 0 & 0 \end{bmatrix}^t \tag{Eq. 14}$$

$$A = \begin{bmatrix} 0 & \frac{w_0}{-D} & 0 & 0 & 0 & 0 \\ \frac{-K_1}{M} & \frac{-D}{M} & \frac{-K_2}{M} & \frac{1}{M} & 0 & 0 \\ \frac{-K_4}{T_{do}} & 0 & \frac{-1}{(K_3 T_{do})} & 0 & 0 & \frac{1}{T_{do}} \\ 0 & 0 & 0 & \frac{-1}{T_i} & \frac{1}{T_i} & 0 \\ 0 & \frac{-1}{RT_g} & 0 & 0 & \frac{-1}{T_g} & 0 \\ \frac{-K_A K_5}{T_A} & 0 & \frac{-K_A K_6}{T_A} & 0 & 0 & \frac{-1}{T_A} \end{bmatrix}$$

### 3. LQR Control Design

Optimal control allows us to directly formulate the performance objectives of control system and produces the best possible control system for a given set of performance objectives. A control system which minimizes the cost associated with generating control inputs is called an optimal control system.

The control energy can be expressed as  $U^*R*U$ , where R is a positive definite square, symmetric matrix called the control cost matrix. Such an expression for control energy is called a quadratic form, because the scalar function,  $U^*R*U$ , contains quadratic functions of the elements of U. Similarly, the transient energy can also be expressed in a quadratic form as  $X^T*Q*X$ , where Q is a positive semi-definite square, symmetric matrix called the state weighting matrix [7].

The objective function can then be written as follows:

$$J(u) = \int_0^{\infty} (X^T Q X + U^T R U) dt \tag{Eq. 15}$$

The optimal control problem consists of solving for the feedback gain matrix, K, such that the scalar objective function, J(u), is minimized if all state variables can be measured.

Where, S is the positive definite matrix solution of the following control algebraic Riccati equation:

$$SA + A^T S + Q - S^* B^* R^{-1} * B^T * S = 0 \tag{Eq. 16}$$

One of the important properties of LQ-regulators is that provided certain conditions are met, they

guarantee nominally stable closed-loop system. The conditions for achieving a stable LQ system are as follows:

$$R > 0, \quad Q \geq 0,$$

(A,B) controllable (stabilizable).

$$[K, S, E] = lqr(A, B, Q, R, N) \tag{Eq. 17}$$

Choosing the weight matrices Q and R usually involves some kind of trial and error, and they are usually chosen as diagonal matrices and N equal to zero.

### 4. Kalman Filter Design

The Kalman filter approach provides us with a procedure for designing observers for multivariable plants. Such an observer is guaranteed to be optimal in the presence of noise signal. Since noise is rarely encountered, the power spectral densities used for designing the Kalman filter can be treated as tuning parameters to arrive at an observer for multivariable plants that has desirable properties, such as performance and robustness. Consider a plant with the following linear time-invariant state-space representation:

$$\dot{X} = AX + BU + w \tag{Eq. 18}$$

$$Y = CX + DU + v \tag{Eq. 19}$$

Where;

w is the process noise vector

v is the measurement noise vector

For designing a control system, Therefore, an observer is required for estimating the state-vector, based upon a measurement of the output, given by Eq.,s 18,19 and known input, U. Kalman filter is an optimal observer, which minimizes a statistical measure of the estimation error,  $e_0 = X - X_0$ , Where  $X_0$  is the estimated state-vector. The state-equation of the Kalman filter can be written as follows:

$$\dot{X}_0 = A^* X_0 + B^* U + L^* (Y - C^* X_0 - D^* U) \tag{Eq. 20}$$

Where;

L is the gain matrix of the Kalman filter.

$$L = S^* C^T * Z^{-1} \tag{Eq. 21}$$

Since the Kalman filter is an optimal observer, the problem of Kalman filter is solved quite similarly to the optimal control problem. For the time-invariant problem, the following algebraic Reccati equation results for the optimal covariance matrix, [6] [7]:

$$A^* S + S^* A^T - S^* C^T * V^{-1} * C^* S + B^* W * B^T = 0 \tag{Eq. 22}$$

Where;

A, B, C, are the plant's state coefficient matrices,

W is the process noise matrix,

V is the measurement noise matrix, and

S is the optimal covariance matrix of the estimation error.

The algebraic Riccati equation can be solved using the specialized Kalman filter MATLAB command lqe. The Kalman filter optimal gain, L, is given by:

$$[L,S,E] = lqe (A,B,C,W,V) \quad \text{Eq. 23}$$

Where

L is the returned Kalman filter optimal gain,

S is the returned solution to the algebraic Reccati equation, and

E is a vector containing the eigenvalues of the Kalman filter (i.e. the eigenvalues of A-LC).

### 5. LQG Controller Design

If a controller is designed using the LQR, and the observer is designed using Kalman filter, the resulting system is referred to as Linear Quadratic Gaussian (LQG) Control or LQG-compensator. In short, the optimal compensator design process is the following [12]:

1. Design an optimal regulator for a linear plant using full-state feedback. The regulator is designed to generate a control input, u(t), based upon the measured state-vector, X.
2. Design a Kalman filter for the plant assuming a known control input, u(t), a measured output, y(t), and white noises, w & v .
3. The Kalman filter is designed to provide an optimal estimate of the state vector, X.
4. Combine the separately designed optimal regulator and Kalman filter into an optimal compensator (LQG), which generates the input vector, u(t), based upon the estimated state-vector, X<sub>o</sub> ,rather than the actual state-vector, X, and the measured output, y(t).

The measurement noise spectral density matrix, the state-space realization of the optimal compensator is given by the following state and output equations [7]:

$$\dot{X}_0 = (A - B * K - L * C + L * D * K) * X_0 + L * Y \quad \text{Eq. 24}$$

$$U = -K * X_0 \quad \text{Eq. 25}$$

Where

K & L are the optimal regulator and Kalman filter gain matrices, respectively, and

X<sub>o</sub> is the estimated state vector.

Figure 3 shows the block diagram of the optimal LQG-compensator [7]. Using MATLAB's Control System Toolbox, a state-space model of the regulating closed-loop system, sysc; can be constructed as follows:

$$\text{sysp} = \text{ss}(A,B,C,D) \quad \text{Eq. 26}$$

$$\text{sysc} = \text{ss} \left( \begin{matrix} A - B * K - L * C \\ +L * D * K, L, K, \text{zeros}(\text{size}(D')) \end{matrix} \right) \quad \text{Eq. 27}$$

$$\text{syscl} = \text{feedback}(\text{sysp}, \text{sysc}) \quad \text{Eq. 28}$$

Where

sysp is the state-space model of the plant,

sysc is the state-space model of the LQG compensator, and

syscl is the state-space model of the closed loop system.

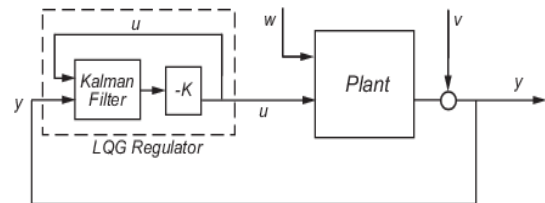


Figure 4: Block diagram of the optimal LQG-compensator.

### 6. Simulation Results

#### 6.1. Model I: Simulation Results

The dynamic stability of power system subjected to load disturbances by using the MATLAB program is proposed by choosing the machine parameters' at nominal operating point [Active power P=1 pu, Reactive power Q=.25 pu].The LQG-controller will applied on the two models of the power system under study. The data sheet of the synchronous machine is given by [8] :

$$X_d = 1.6, X_q = 1.55, X_{dd} = 0.32,$$

$$X_e = 0.4, E = 1, T_{do} = 6, M = 10,$$

$$\omega_o = 377, D = 0, K_A = 25, T_A = 0.06$$

The state coefficient matrices A, B of the 4th order plant with the given data sheet of synchronous

machine discussed in [5]. are calculated at the nominal operating point (Active power P=1 pu, Reactive power Q=0.25 pu ) as :

$$A = \begin{pmatrix} 0 & 377 & 0 & 0 \\ -1.1317 & 0 & -1.1104 & 0 \\ -2.2356 & 0 & -4.463 & .1667 \\ 15.4703 & 0 & -194.8383 & -16.6667 \end{pmatrix},$$

$$B = \begin{pmatrix} 0 \\ 0 \\ 0 \\ 416.6667 \end{pmatrix}, \quad C = (1 \quad 1 \quad 0 \quad 0)$$

The optimal regulator feedback gain matrix, K, is calculated with the Q, R matrices as follows:

$$Q = \begin{pmatrix} 1 & 0 & 0 & 0 \\ 0 & 1 & 0 & 0 \\ 0 & 0 & 1 & 0 \\ 0 & 0 & 0 & .001 \end{pmatrix}, \quad R = [50]$$

From Eq.17, we the value of lqr feedback gain as;

$$K\_lqr = (0.1217 \quad -0.1090 \quad 0.1292 \quad 0.0015)$$

$$S = \begin{pmatrix} 1.8 & 0 & 1.5 & 0 \\ 0 & 5329.5 & -34.4 & 0 \\ 1.5 & -34.4 & 1.9 & 0 \\ 0 & 0 & 0 & 0 \end{pmatrix}$$

The Kalman filter optimal gain matrix, L, is calculated with the W, V matrices at the nominal operating point (P=1 pu, Q=-.25 pu) as follows:

$$w = 10 * B^T * B, \quad v = 0.01 * C * C^T$$

From Eq.23, we the value of Kalman filter gain as;

$$L = 1.0e+006 * \begin{pmatrix} 0.0000 \\ 0.0001 \\ 0.0267 \\ 2.6089 \end{pmatrix}$$

, illustrates the digital simulation results of eigenvalues calculations for power system at different operation points with and without controllers of model I.

Figure 5 shows the rotor speed deviation response due to 0.1 pu load disturbance with and without controllers at (p=1 pu, Q=0.25 pu). While Figure 7 depict the rotor speed deviation response due to 0.1 pu load disturbance with and without controllers at (p=1 pu, Q=0.7 pu) .

Figure 6 displays the rotor speed deviation response due to 0.1 pu load disturbance with and without controllers at (p=0.5 pu, Q=-0.15 pu).

Finally the rotor speed deviation response due to 0.1 pu load disturbance with and without controllers at lead power factor (p=1 pu, Q=-0.25 pu) are shown in Figure 8.

The settling time calculations of model-I power system at different operation points, with and without controllers is shown in Table 2.

Table 1: Eigenvalues analysis of power system with and without controllers

Operating Point (P,Q)	Without Control	With LQR Control	With LQG Control	Remark
(1, .25) Normal Load	-14.2951 -0.0363 + 7.0074i -0.0363 - 7.0074i -2.7619	-14.4038 -0.2429 + 7.0208i -0.2429 - 7.0208i -2.8707	-23.4250 +39.4557i -23.4250 -39.4557i -46.0711 -14.5977 -0.5641 + 7.0185i -0.5641 - 7.0185i -0.0185 -3.0493	Rotor speed deviation, oscillations is shown in Figure 5
(1, 0.7) Heavy Load	-14.0142 -0.0194 + 7.6654i -0.0194 - 7.6654i -3.0767	-14.0764 -0.1555 + 7.6781i -0.1555 - 7.6781i -3.3672	-21.7113 +36.6323i -21.7113 -36.6323i -42.6908 -0.3654 + 7.6767i -0.3654 - 7.6767i -0.0284 -3.8425 -14.1911	Rotor speed deviation, oscillations is shown in Figure 7
(0.5, 0.15) Light Load	-14.1781 -0.1486 + 6.0497i -0.1486 - 6.0497i -2.6542	-14.2491 -0.3606 + 6.0356i -0.3606 - 6.0356i -2.7844	-21.4194 +35.7836i -21.4194 -35.7836i -42.0869 -0.6897 + 5.9837i -0.6897 - 5.9837i -0.0174 -3.0088 -14.3790	Rotor speed deviation, oscillations is shown in Figure 6

(1, -0.25) Lead PF	-14.9002	-15.0445	--25.0515 +42.0976i	Rotor speed deviation, oscillations is shown in Figure 8
	0.1021 + 6.3167i	-0.2068 + 6.3348i	-25.0515 -42.0976i	
	0.1021 - 6.3167i	-0.2068 - 6.3348i	-49.3002	
	-2.4336	-2.2966	-15.2945	
	Un-stable		-0.6953 + 6.3571i	
			-0.6953 - 6.3571i	

Table 2, Settling time for single machine model with and without controllers

	Without Control	LQR- Control	LQG- Control
P=1, Q=0.25 pu. Normal load	> 10 Sec.	> 10 Sec.	6.5 Sec.
P=1, Q=0.7 pu., Heavy load	> 10 Sec.	> 10 Sec.	9 Sec.
P=0.5, Q=0.15 pu. Light load	> 10 Sec.	9 Sec.	5.5 Sec.
P=1, Q= -0.25 pu. Lead P.F. load		> 10 Sec	4 Sec.

∞

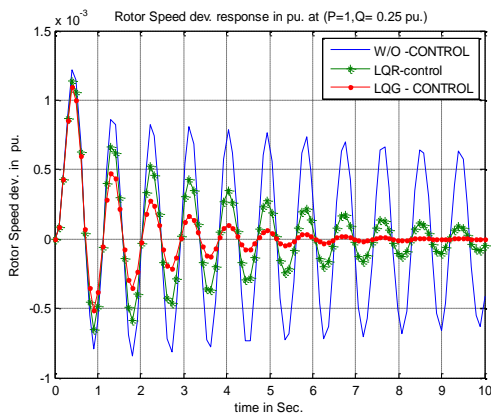


Figure 5 : Rotor speed dev. response due to 0.1 pu load disturbance with and without controllers, at (p=1 pu , Q=.25 pu ).

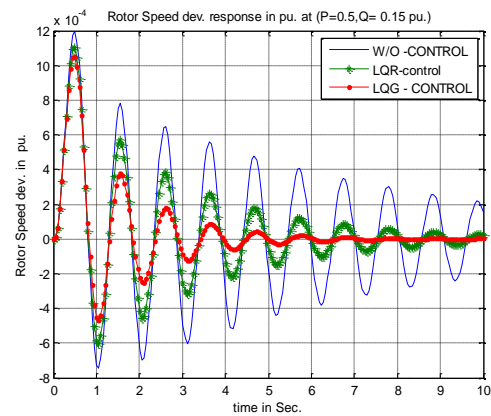


Figure 6: Rotor speed dev. response due to 0.1 pu load disturbance with and without controllers at lead power factor load (p=1.1 pu , Q=-.3 pu ).

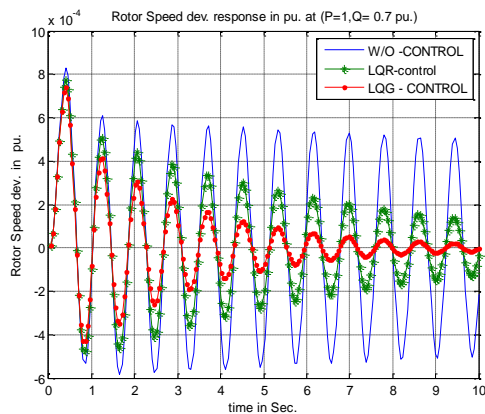


Figure 7: Rotor speed dev. response due to 0.1 pu load disturbance with and without controllers at (p=1.1 pu , Q=.75 pu ).

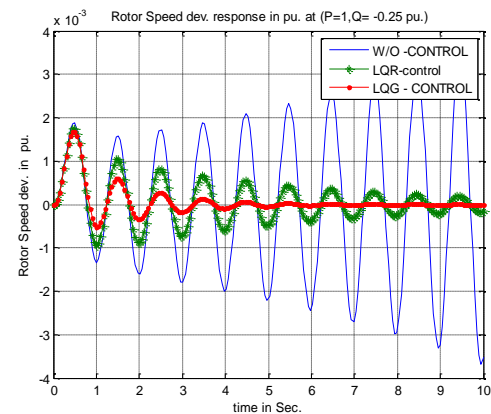


Figure 8 : Rotor speed dev. response due to 0.1 pu load disturbance with and without controllers at lead power factor load (p=1.1 pu , Q=-.82 pu ).

### 6.2. Model II: Simulation Results

The following mathematical linearized state space model represents a power system which consists of synchronous machine connected to infinite bus through transmission line [9], [10]; The

block diagram is shown in Figure 3. Choosing the machine parameters and nominal operating point as;

$$X_d = 1.6; X_q = 1.55;$$

$$X_d' = 0.32; X_e = 0.4 p.u$$

$$\begin{aligned} \omega_0 &= 377; M = 10; T_{d0} = 6; \\ D &= 0; T_A = 0.06; \\ K_A &= 25(P = 1; Q = 0.25); \\ T_i &= 0.08; R = 1.82; re = 0 \end{aligned}$$

From LQR control (Eq. 17), the feedback gain and solution of Reccati equation are:

$$K_{LQR} = \begin{bmatrix} 0.0265 & -0.3333 & -0.0390 & 0.0507 & -0.0144 & 0.0037 \\ 0.0212 & -0.2213 & 0.0740 & 0.0003 & -0.0229 & 0.1461 \end{bmatrix}$$

From LQG and Kalman filter control (Eqn. 23), the observer gain matrix L and solution of reccati equation P are:

$$L = 1.0e+9 * \begin{bmatrix} 0.0000 & 0.0000 \\ 0.0000 & 0.0000 \\ -0.0036 & -0.0007 \\ -5.0807 & -0.6302 \\ 0.0000 & 0.0000 \\ -0.0001 & -0.0000 \end{bmatrix}$$

$$P = 1.0e+11 * \begin{bmatrix} 0.0000 & 0.0000 & -0.0000 & -0.0000 & 0.0000 & -0.0000 \\ 0.0000 & 0.0000 & -0.0000 & -0.0000 & 0.0000 & -0.0000 \\ -0.0000 & -0.0000 & 0.0000 & 0.0004 & 0.0000 & -0.0000 \\ -0.0000 & -0.0000 & 0.0004 & 1.1742 & 0.0000 & -0.0001 \\ 0.0000 & 0.0000 & 0.0000 & 0.0000 & 0.0000 & -0.0000 \\ -0.0000 & -0.0000 & -0.0000 & -0.0001 & -0.0000 & 0.0000 \end{bmatrix}$$

Figure 9 shows the rotor angle deviation response due to 0.1 load disturbance with and without LQG and LQR controllers at lag power factor load (P=1, Q=0.25 pu).

Figure 10 depicts the rotor speed deviation response due to 0.1 load disturbance with and without LQG and LQR controllers at lag power factor load (P=1, Q=0.7 pu).

Figure 11 shows the rotor speed deviation response due to 0.1 load disturbance with and without LQG and LQR controllers at lead power factor load (P=0.5, Q= 0.15 pu) ,

Figure 12 shows the rotor speed deviation response due to 0.1 load disturbance with and without LQG and LQR controllers at lead power factor load (P=1, Q= -0.25 pu).

Moreover, Table 3 shows the Settling time for single machine model with and without controllers at different operating conditions.

Table 4 displays the Eigenvalues calculation with and without controllers for single machine power system.

Table 3, Settling time for single machine model with and without controllers

Operating points	Without Control	LQR- Control	LQG- Control
P=1, Q=0.25 pu. Normal load	> 10 Sec.	> 10 Sec.	6 Sec.
P=1, Q=0.7 pu. Heavy load	> 10 Sec.	> 10 Sec.	9.5 Sec.
P=0.5, Q=0.15 pu. Light load	> 10 Sec.	> 10 Sec.	8 Sec.
P=1, Q= -0.25 pu. Lead P.F. load	∞	> 10 Sec	3 Sec.

Table 4: Eignvalues calculation with and without controllers of single machine power system

Operating point (P,Q)	Without control	With LQR control	With LQG control	remark
(1,25) Normal Load	-0.0367 + 6.9961i -0.0367 - 6.9961i -14.2953 -12.4821 -2.7625 -3.7201	-36.9779 -14.2321 -0.1110 + 7.0260i -0.1110 - 7.0260i -1.1061 -3.7466	1.0e+002 * -3.5443 + 3.1680i -3.5443 - 3.1680i -3.5623 -0.9704 + 3.1207i -0.9704 - 3.1207i -0.0017 + 0.0704i -0.0017 - 0.0704i -0.1423 -0.1250 -0.0019 -0.0377 -0.0371	Rotor speed deviation, oscillations is shown in Figure 9



<p>(1, 0.7) heavy load</p>	<p>-0.0204 + 7.6552i -0.0204 - 7.6552i -14.0144 -12.4829 -3.7181 -3.0771</p>	<p>-36.8864 -14.2317 -0.0684 + 7.6758i -0.0684 - 7.6758i -1.2742 -3.7555</p>	<p>1.0e+002 * -3.3674 + 3.0526i -3.3674 - 3.0526i -3.5144 -0.8119 + 2.9637i -0.8119 - 2.9637i -0.0011 + 0.0768i -0.0011 - 0.0768i -0.1423 -0.1250 -0.0033 -0.0378 -0.0371</p>	<p>Rotor speed deviation, oscillations is shown in Figure 10</p>
<p>(0.5, 0.15) Light Load</p>	<p>-0.1479 + 6.0363i -0.1479 - 6.0363i -14.1778 -12.4819 -2.6593 -3.7186</p>	<p>-36.9221 -14.2328 -0.1549 + 6.0546i -0.1549 - 6.0546i -1.0961 -3.7238</p>	<p>1.0e+002 * -3.3246 + 3.0248i -3.3246 - 3.0248i -3.5016 -0.7765 + 2.9261i -0.7765 - 2.9261i -0.0016 + 0.0607i -0.0016 - 0.0607i -0.1423 -0.1250 -0.0025 -0.0375 -0.0372</p>	<p>Rotor speed deviation, oscillations is shown in Figure 11</p>
<p>(1, -0.25) Lead PF</p>	<p>0.1033 + 6.3047i 0.1033 - 6.3047i -14.9008 -12.4804 -2.4303 -3.7285 Unstable</p>	<p>-37.2057 -14.2319 -0.1060 + 6.3558i -0.1060 - 6.3558i -3.7440 -0.8909</p>	<p>1.0e+002 * -3.7002 + 3.2728i -3.7002 - 3.2728i -3.5988 -1.1326 + 3.2653i -1.1326 - 3.2653i -0.0027 + 0.0638i -0.0027 - 0.0638i -0.1423 -0.1250 0.0003 -0.0376 -0.0371</p>	<p>Rotor speed deviation, oscillations is shown in Figure 12</p>

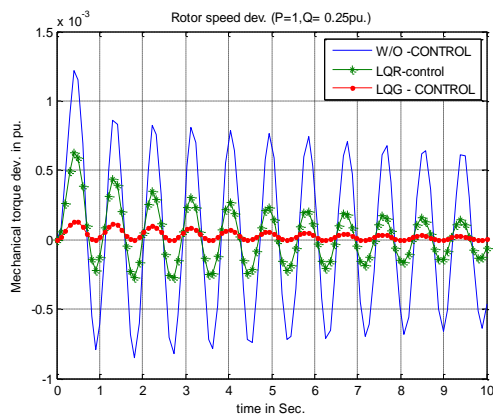


Figure 9: Rotor angle dev. Response due to 0.1 load disturbance with and without LQG and LQR controllers at lag power factor load (P=1, Q=0.25 pu)

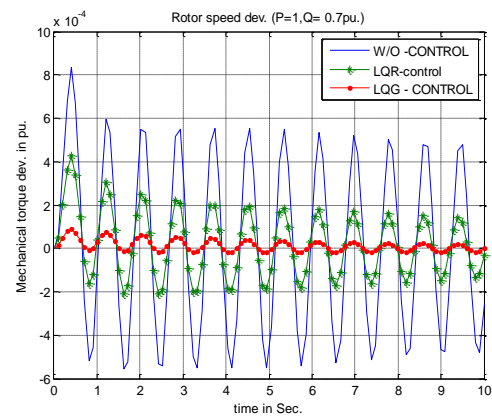


Figure 10: Rotor speed dev. Response due to 0.1 load disturbance with and without LQG and LQR controllers at lag power factor load (P=1, Q=0.7 pu)

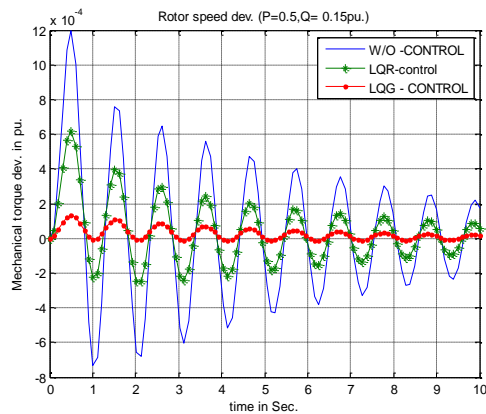


Figure 11: Rotor speed dev. Response due to 0.1 load disturbance with and without LQG and LQR controllers at lead power factor load ( $P=0.5$ ,  $Q=0.15$  pu)

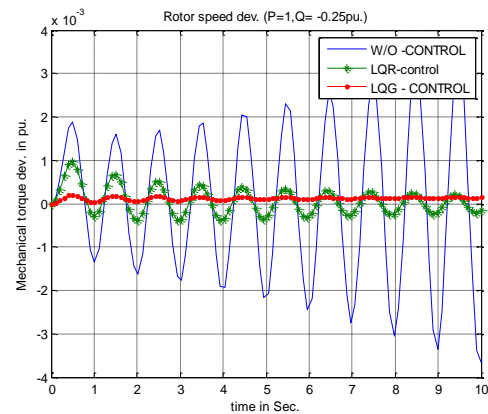


Figure 12: Rotor speed dev. Response due to 0.1 load disturbance with and without LQG and LQR controllers at lead power factor load ( $P=0.5$ ,  $Q=0.15$  pu)

## 7. Discussions

The simulation results of Model I show the effect of the proposed LQG controller for damping the dynamic oscillation on power system in a wide range of operating conditions. The power system under study at the operating points (1,-0.25) is unstable system in case of without control as shown in Figures 8, 12. After the effect of the control based on LQR the system became stable. Moreover, after the effect of the proposed control based on LQG, the system became fast damping at all operating points see the eigenvalues in Tables 1,2,3,4. Also, Tables 2, 4 shows the settling time in case of proposed LQG controller is less than that in case of LQR controller at all operating conditions.

## 8. Conclusion

This paper presented a proposed robust controller based on Linear Quadratic Gaussian LQG theory to design a power system stabilizer for single-machine infinite-bus power systems. The proposed approach overcomes the problems of the linear controls by explicitly using a nonlinear model of the power system for control synthesis.

The proposed robust linear quadratic Gaussian control LQG-PSS is design and applicator of the power system under study. The comparison shows that the proposed robust LQG controller is effective and robust in suppressing large disturbances, as well as enhancing the power system stability. It is also suitable for a wide range of operating conditions of the power system compared with the conventional linear quadratic control LQR-PSS.

The LQG optimal control has been developed to be included in power system in order to improve the dynamic response and gives the optimal performance at any loading condition. The LQG is better than LQR controller in terms of small settling time and less overshoot and under shoot. The digital simulation results show that the proposed PSS based

upon the LQG can achieve good performance over a wide range of operating conditions.

## Bibliography

- [1] N.K. Roy, H.R. Pota, and M.A. Mahmud, "Design of a Norm-Bounded LQG Controller for Power Distribution Networks with Distributed Generation," *2012 Australian Control Conference, 15-16 November 2012, Sydney, Australia*.
- [2] Argyrios C. Zolotas, Balarko Chaudhuri, Imad M. Jaimoukha, and Petr Korba, "A Study on LQG/LTR Control for Damping Inter-Area Oscillations in Power Systems," *IEEE TRANSACTIONS ON CONTROL SYSTEMS TECHNOLOGY, VOL. 15, NO. 1, JANUARY 2007*.
- [3] Ibraheem K. Ibraheem, " Damping Low Frequency Oscillations in Power System using Quadratic Gaussian Technique based Control System Design," *International Journal of Computer Applications (0975 – 8887), Volume 92 – No.11, April 2014*.
- [4] Xuejiao Yang and Ognjen Marjanovic, "LQG Control with Extended Kalman Filter for Power Systems with Unknown Time-Delays," *Preprints of the 18th IFAC World Congress, Milano (Italy) August 28 - September 2, 2011*.
- [5] Qi-bing JIN, Shi-bing REN, Ling Quan, "LQG Optimum Controller Design and Simulation Base on Inter Model Control Theory," *978-1-4244-4738-1/09/\$25.00 ©2009 IEEE..*
- [6] S.S. Lee and J.K. Park, "Design of reduced-

order observer-based variable structure power system stabiliser for unmeasurable state variables," *IEE Proceedings of the Generation, Transmission and Distribution*, vol. 145, No. 5 (September 1998), pp. 525–530.

- [7] Ashish Tewari, "Modern Control Design With Matlab And Simulink," *Book-2003*..
- [8] M.K. El-Sherbiny, M.M. Hasan, G. El-Saady, Ali M. Yousef, "Optimal pole shifting for power system stabilization," *Electrical power system research journal*, No 66 pp.253-258,2003..
- [9] Ali M. Yousef, Ahmed M. Kassem, " Optimal Power System Stabilizer Based Enhancement of Synchronizing And Damping Torque Coefficients," *WSEAS TRANSACTIONS on POWER SYSTEMS*, Issue 2, Volume 7, April 2012.
- [10] Ahmed Said Oshaba, " Stability of Multi-Machine Power System by used LQG Controller," *WSEAS TRANSACTIONS on POWER SYSTEMS*, Volume 9, 2014.